


THIS DRAWING MAY BE USED ONLY FOR THE PURPOSE INTENDED AND ONLY WRITTEN DIMENSIONS SHALL BE USED

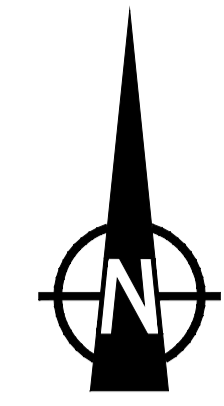

- KEY**
- SWS— PROPOSED PRIVATE SURFACE WATER SEWER AND MANHOLE. SEWER TO BE 150mm IN DIAMETER UNLESS STATED OTHERWISE. MANHOLE TYPE AND COVER TYPE IS AS STATED.
 - SWS— PROPOSED PRIVATE RODDING EYE 0.30m TO PIPE INVERT.
 - FS— PROPOSED PRIVATE FOUL WATER SEWER AND MANHOLE. SEWER TO BE 100mm IN DIAMETER UNLESS STATED OTHERWISE. MANHOLE TYPE AND COVER TYPE IS AS STATED.

- NOTES:**
1. ALL DIMENSIONS IN METERS UNLESS STATED OTHERWISE.
 2. ALL PRIVATE DRAINAGE WORKS ARE TO COMPLY WITH THE REQUIREMENTS OF BS 752 BUILDING DRAINAGE AND BUILDING REGULATIONS 2000 APPROVED DOCUMENT H 2002 EDITION. ALL ADOPTABLE DRAINAGE TO COMPLY WITH THE REQUIREMENTS OF SEVERN TREAT WATER AND SEWERS FOR ADOPTION (6th EDITION), INCLUDING THE RELEVANT PROVISIONS OF THE COMBINED ADDENDUM.
 3. ALL MATERIALS, UNLESS SPECIFIED OTHERWISE, SHALL COMPLY WITH THE RELEVANT BRITISH STANDARD. SOURCES OF MATERIALS ARE TO BE AGREED WITH THE EMPLOYER'S REPRESENTATIVE/ENGINEER IN ADVANCE OF THE WORKS.
 4. ANY DISCREPANCIES IN THE DETAILS SHOWN TO BE REPORTED TO THE EMPLOYER'S REPRESENTATIVE/ENGINEER PRIOR TO CONSTRUCTION.
 5. LOCATION AND LEVELS OF EXISTING DRAINAGE RUNS ARE BASED UPON SEWER RECORD PLANS AND MUST BE CHECKED ON SITE PRIOR TO THE COMMENCEMENT OF ANY DRAINAGE WORKS.
 6. ALL EXISTING SERVICES TO BE LOCATED PRIOR TO THE COMMENCEMENT OF ANY DRAINAGE WORKS WHERE NECESSARY PROTECTION OR DIVERSIONS TO BE UNDERTAKEN TO AVOID CONFLICT WITH THE PROPOSED WORKS.
 7. ALL ADOPTABLE DRAINAGE AND FITTINGS TO BE FLEXIBLY JOINTED CLAYWARE TO BS EN295 OR CONCRETE TO BS5911 PART 100. FLEXIBLY JOINTED UPVC PIPES AND FITTINGS TO BS EN 413-05 MAY BE USED FOR PRIVATE BUILDING DRAINAGE SYSTEMS ONLY.
 8. TYPICAL PIPE BEDDING TO DRAINAGE WHERE DEPTH TO SOFFIT IS GREATER THAN 600mm IN LANDSCAPED AREAS AND GREATER THAN 1200mm IN ADOPTABLE HIGHWAYS AND 900mm IN OTHER TRAFFICED AREAS IS TO BE CLASS 5 (I.E. 10-14mm GRADED IMPORTED GRANULAR $C_{100} < A_{10} < A_{15} < A_{20} < A_{25} < A_{30} < A_{35} < A_{40} < A_{45} < A_{50} < A_{55} < A_{60} < A_{65} < A_{70} < A_{75} < A_{80} < A_{85} < A_{90} < A_{95} < A_{100}$ - 40mm GRADED IMPORTED GRANULAR BED AND $U_{100} < U_{110} < U_{120} < U_{130} < U_{140} < U_{150} < U_{160} < U_{170} < U_{180} < U_{190} < U_{200}$).
 9. BACKFILL TO DRAINAGE TRENCHES UNDER CARRIAGEWAYS TO BE TYPE 1 SUB-BASE MATERIAL. ELSEWHERE BACKFILL TO BE FREE DRAINING READILY COMPATIBLE MATERIAL. FREE FROM RUBBISH AND ORGANIC MATTER, FROZEN SOIL CLAY LUMPS AND LARGE STONES. TO BE COMPACTED IN LAYERS NOT EXCEEDING 150mm THICK.
 10. CONCRETE MIXES INDICATED ON THIS DRAWING ARE DESIGNATED MIXES CONFORMING TO BS 8500-1, 2002.
 11. A FLEXIBLE JOINT SHALL BE PROVIDED AS CLOSE AS IS FEASIBLE TO OUTSIDE FACE OF ANY STRUCTURE INTO WHICH A PIPE IS BUILT. COMPATIBLE WITH THE SATISFACTORY COMPLETION AND SUBSEQUENT MOVEMENT OF THE JOINT. THE LENGTH OF THE NEXT PIPE (ROCKER PIPE) AWAY FROM THE STRUCTURE SHALL BE AS SHOWN IN THE TABLE BELOW.

NOMINAL DIAMETER (mm)	EFFECTIVE LENGTH (m)
150-600	0.6
675-750	1.0
825 AND OVER	1.25

Revision Details	By	Date	Suffix

Drawing Number: **J01026/A1/008**

**BENTLEY ROAD
NORTH
WALSALL**

Drawing Title: **AREA
PLAN**

Scale at A1	Detailed	Approved
1:200		James Mew's
Drawn	Tech Chk	Det Chk
RJS	JJM	JJM
Date		
20.03.2008		

www.jnmengineering.co.uk

84 Lloyds Head, Jackfield
Ironbridge, TF8 7LZ.
Tel: 01952 885767
info@jnmengineering.co.uk
Company Registration Number: 05782540

